
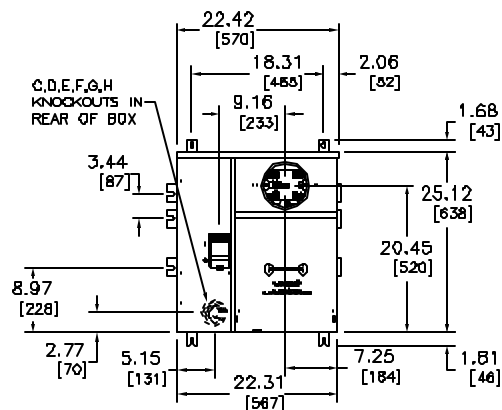


FOR METERING EQUIPMENT SHORT CIRCUIT CURRENT RATINGS
REFER TO SQUARE D DIGEST 173, PAGE 2-9.


TENANT CIRCUIT BREAKERS (ORDER ONE PER SOCKET POSITION)			
TENANT CIRCUIT BREAKER (2-POLE)	AMPERE RATINGS MIN. - MAX.	SHORT CIRCUIT BREAKER RATING RMS SYMMETRICAL AMPERES MAX.	VOLTS MAX.
QD	40 - 125	10,000	120/240
QBP-TM	70 - 225	10,000	
QD-VH	40 - 60	22,000	
QBP-TM	70 - 225	25,000	
QDH	40 - 60	42,000	
QGP-TM	70 - 225	65,000	
QVP-TM	70 - 225	100,000	

FOR QD TYPE CIRCUIT BREAKERS ADAPTER KIT CAT. NO. EZM125QDA IS REQUIRED (ORDER SEPARATELY, ONE KIT PER POSITION).


KNOCKOUT SCHEDULE	
SYMBOL	CONDUIT SIZE
A	.50
B	.75
C	1.00
D	1.25
E	1.50
F	2.00
G	2.50
H	3.00



TOP MOUNTING BRACKET



BOTTOM MOUNTING BRACKET

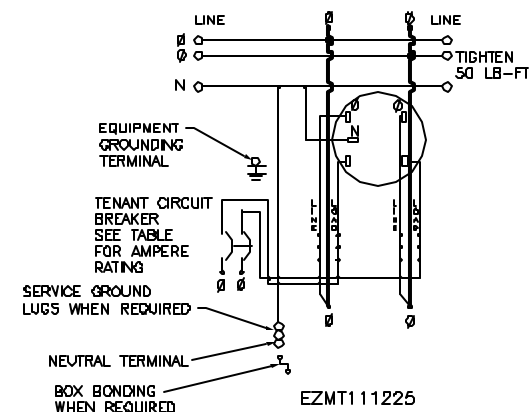

DUAL DIMENSIONS: INCHES
[MILLIMETERS]

NOTES:
FINISH: GRAY BAKED ENAMEL POWDER COAT PAINT OVER CLEANED GALVANNEALED STEEL.
UL LISTED - FILE E-131840, VOL. M
SUITABLE FOR USE AS SERVICE EQUIPMENT.
MAIN HORIZONTAL CROSS BUS RATED 1200A,
100,000 RMS SYMMETRICAL AMPERES MAXIMUM
METER CENTER SHORT CIRCUIT CURRENT RATING.
UNMETERED COMPARTMENTS ARE SEALABLE BY UTILITY.
GANGABLE MULTI-METERING EQUIPMENT IS DESIGNED FOR WALL MOUNTING
ONLY (NOT SUITABLE FOR USE AS FLOOR STANDING EQUIPMENT).

SYSTEM TYPE (IN)	SERVICE PROVIDED (OUT)	MAIN BUS RATING	CATALOG NUMBER	METER SOCKET TYPE		NUMBER OF POSITIONS
1PH-3W 120/240 VAC	1PH-3W 120/240 VAC	1200 A	EZMT111225	5-JAW PLUG-IN WITH TEST BLOCK BYPASS SUPPLIED WITH RING STYLE TRIM		1
TENANT CIRCUIT BREAKER (ORDER SEPARATELY)		POLES	AMPERE RATING	NEUTRAL WIRE RANGE	SERVICE GROUND WIRE RANGE	EQUIPMENT GROUNDING WIRE RANGE
2-POLE SEE TABLE ABOVE		2	225	#4-300 KCMIL CU/AL	#4-300 KCMIL CU/AL	#14-2/0 AWG CU #12-2/0 AWG AL

ONE POSITION EZ METER-PAK METERING EQUIPMENT
BRANCH UNIT INCLUDES METER SOCKET WITH
TEST BLOCK BYPASS, AND PROVISIONS FOR
MOUNTING 225A MAX. TENANT CIRCUIT BREAKER
NEMA TYPE JR ENCLOSURE

SQUARE D
Schneider Electric

DWG# 3272
NO.