


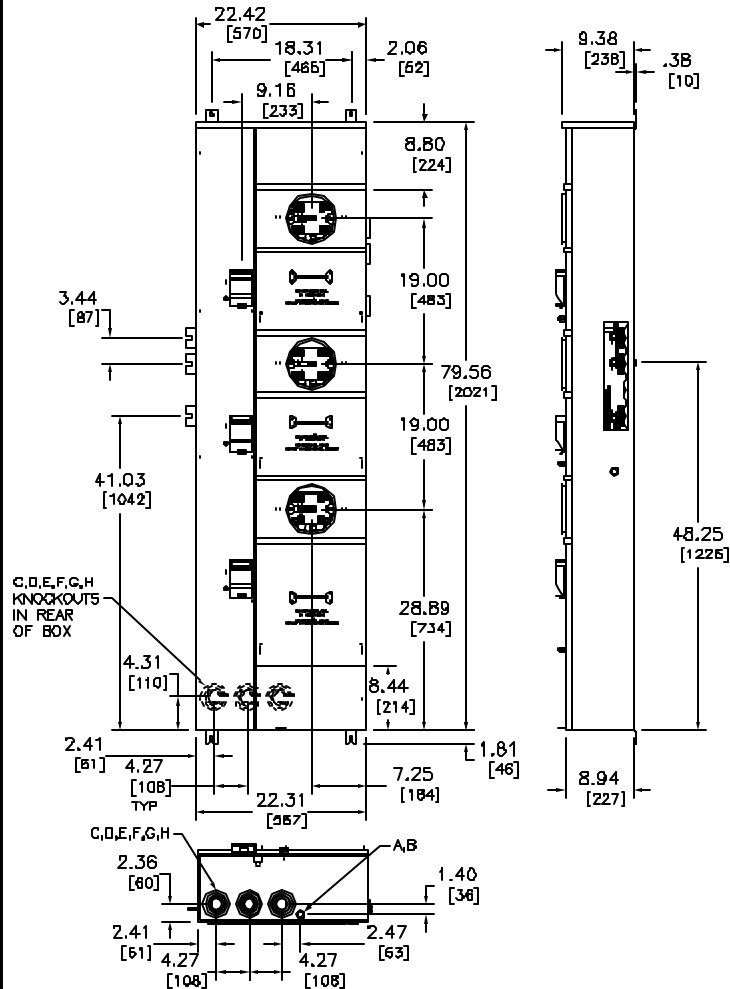

NOTES:
 FINISH: GRAY BAKED ENAMEL POWDER COAT PAINT OVER CLEANED GALVANNEALED STEEL.
 UL LISTED - FILE E-131840, VOL. M
 SUITABLE FOR USE AS SERVICE EQUIPMENT.
 MAIN HORIZONTAL CROSS BUS RATED 1200A.
 100,000 RMS SYMMETRICAL AMPERES MAXIMUM.
 METER CENTER SHORT CIRCUIT CURRENT RATING.
 UNMETERED COMPARTMENTS ARE SEALABLE BY UTILITY.
 GANGABLE MULTI-METERING EQUIPMENT IS DESIGNED FOR WALL MOUNTING ONLY (NOT SUITABLE FOR USE AS FLOOR STANDING EQUIPMENT).


SYMBOL	CONDUIT SIZE
A	.50
B	.75
C	1.00
D	1.25
E	1.50
F	2.00
G	2.50
H	3.00

TENANT CIRCUIT BREAKERS (ORDER ONE PER SOCKET POSITION)			
TENANT CIRCUIT BREAKER (2-POLE)	AMPERE RATINGS MIN. - MAX.	SHORT CIRCUIT BREAKER RATING RMS SYMMETRICAL AMPERES MAX.	VOLTS MAX.
QO	40 - 125	10,000	120/240
QBP-TM	7D - 225	10,000	
QO-VH	40 - 60	22,000	
QDP-TM	7D - 225	25,000	
QOH	40 - 60	42,000	
QGP-TM	7D - 225	65,000	
QWP-TM	7D - 225	100,000	


FOR QD TYPE CIRCUIT BREAKERS ADAPTER KIT CAT. NO. EZM12500A IS REQUIRED (ORDER SEPARATELY, ONE KIT PER POSITION).

FOR METERING EQUIPMENT SHORT CIRCUIT CURRENT RATINGS REFER TO SQUARE D DIGEST 173, PAGE 2-9.

NOT APPLICABLE TO 1PH IN DEVICE.




BOTTOM MOUNTING BRACKET



TOP MOUNTING BRACKET

NOTE:
 THIS DEVICE DOES NOT MEET EUSERC REQUIREMENTS FOR OUTDOOR INSTALLATIONS: METERS SHALL BE LOCATED NOT MORE THAN 75 INCHES AND NOT LESS THAN 48 INCHES ABOVE THE GROUND OR STANDING SURFACE WHEN INSTALLED OUTDOORS.
 WHEN METERS ARE ENCLOSED IN A CABINET OR INDOORS IN A METER ROOM, THE MINIMUM HEIGHT MAY BE REDUCED TO 36 INCHES.
 THE METER HEIGHT SHALL BE MEASURED TO THE METER AXIS. EXCEPTION: UTILITIES IN SNOW AREAS MAY REQUIRE INCREASED HEIGHT.

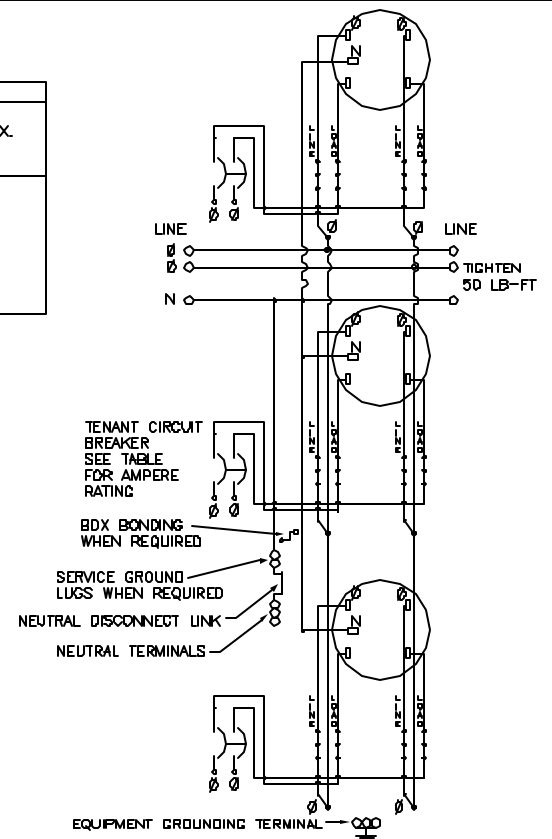

DUAL DIMENSIONS: INCHES [MILLIMETERS]

EZMT113225

TENANT CIRCUIT BREAKER (ORDER SEPARATELY)	NEUTRAL AND SERVICE GROUND WIRE RANGE	EQUIPMENT GROUNDING WIRE RANGE
2-POLE SEE TABLE ABOVE	#4-300 KCMIL CU/AL	#14-2/0 AWG CU #12-2/0 AWG AL

SYSTEM TYPE (IN)	SERVICE PROVIDED (OUT)	MAIN BUS RATING	CATALOG NUMBER	METER SOCKET TYPE	NUMBER OF POSITIONS
1PH-3W 120/240 VAC	1PH-3W 120/240 VAC	1200 A	EZMT113225	5-JAW TEST BLOCK BYPASS RING STYLE	3

THREE POSITION EZ METER-PAK METERING EQUIPMENT BRANCH UNIT INCLUDES METER SOCKETS WITH TEST BLOCK BYPASS, AND PROVISIONS FOR MOUNTING 225A MAX. TENANT CIRCUIT BREAKER NEMA TYPE 3R ENCLOSURE (REFER TO NOTE ABOVE)



DWG# 3274
 NO.