REPLACEMENT COVER WITH LED INDICATORS
USE ONLY REPLACEMENT COVER HBLDS6SSRRCP,
HBLS10SSRRCP
WITH HUBELL INC. CAT NO.
HBLDS6SSR & HBLDS10SSR SERIES ENCLOSURES
NSF CERTIFIED AND IP69K RATING

60A & 100A REPLACEMENT COVERS: HBLDS6SSRRCP
HBLDS10SSRRCP

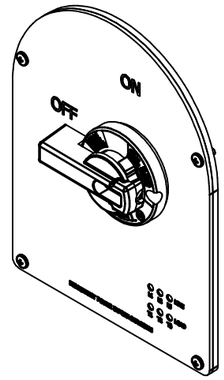

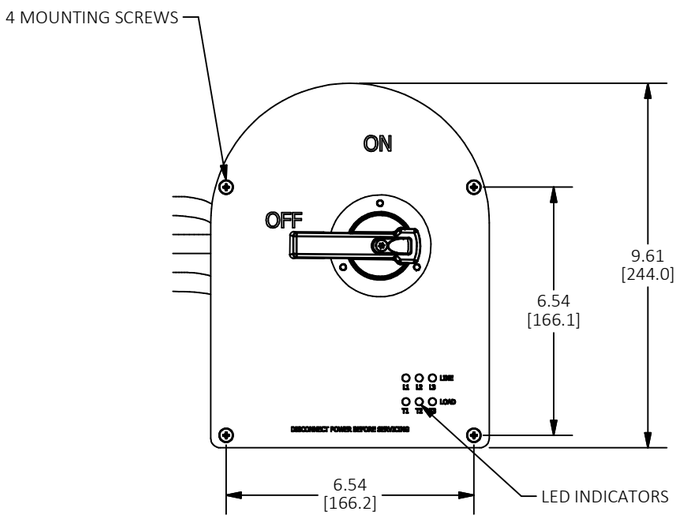

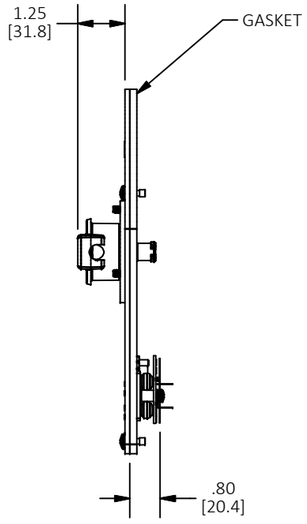

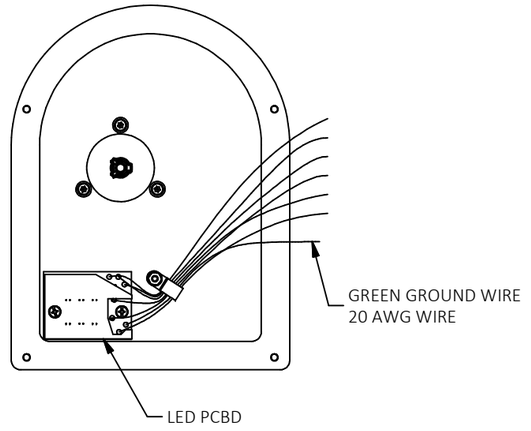



NOTES:
1. CATALOG NUMBERS: HBLDS6SSRRCP, HBLDS10SSRRCP.
2. DIMENSIONS SHOWN ARE IN INCHES [mm].
3. ENCLOSURE TYPE 4X & 12
4. cULus LISTED
5. FOR INSTRUCTION OF REPLACEMENT COVER REFER TO PD2787 INSTALLATION INSTRUCTION.

CAT NO.'S HBLDS6SSRRCP, HBLDS10SSRRCP	
HP	VOLTAGE
7.5 HP (5.6kW)	120 VAC 1 Ø
15 HP (11.19 kW)	200-240 VAC 1 Ø
30 HP (22.37 kW)	480 VAC 1 Ø
30 HP (22.37 kW)	200-240 VAC 3 Ø
50 HP (37.28 kW)	480 VAC 3 Ø
50 HP (37.28 kW)	600 VAC 3 Ø

CAGE CODE 74545

LIST OF PARTS

DESCRIPTION	MATERIAL	FINISH
ENCLOSURE & HARDWARE	STAINLESS STEEL	
HANDLE & MOUNT	PBT	
GASKET	EPDM FOAM	
CONDUIT HUB	ZINC	
LED/PCBD		
LENS	PC	
GROUND BUS		

SCALE: 1/8
EMBEDED 3D CAD MODEL IN
"M-13889_ACAD.dwg"

REV	DESCRIPTION	APP	DATE
1	RELEASED PER DCN #23623 AD	TLS	06/04/18

THE DESIGN AND DIMENSIONS OF THE PRODUCT SHOWN ON THIS DRAWING ARE SUBJECT TO CHANGE WITHOUT NOTICE. DIMENSIONS ARE IN INCHES [mm].

TITLE

CIRCUIT-LOCK™ 60/100 AMP STAINLESS STEEL DISCONNECT SWITCH, LED INDICATORS

WIRING DEVICE-KELLEMS
HUBBELL INCORPORATED
SHELTON, CT

TOLERANCES UNLESS OTHERWISE SPECIFIED
.XX = ± .01
.XXX= ± .005
ANGLE TOL. ±2'

DR. BY	AD	SCALE	1 / 4
CHK. BY	CAC	DATE	03/13/18

DIMENSION SHEET FOR CAT. NO.
HBLDS6SSRRCP, HBLDS10SSRRCP

B

M-13889

1